


Residential Label Guide NEC 2020

5/19/2023

<p>Utility Meter & Service Equipment</p> <p>Multiple sources of AC power Sticker NEC 2020 705.12 (C)</p> <div style="border: 1px solid black; padding: 5px; background-color: #c00000; color: white; text-align: center;"> <p>⚠ WARNING ⚠</p> <p>THREE POWER SOURCES</p> <p>SOURCES: UTILITY GRID, BATTERY AND PV SOLAR ELECTRIC SYSTEM</p> </div>
<p>Electric Distribution Panel</p> <p>Terminals on the line and load side sticker NEC 2020 690.13 (B)</p> <div style="border: 1px solid black; padding: 10px; background-color: #fff; text-align: center;"> <div style="background-color: #e67e22; color: white; padding: 5px; display: inline-block;">⚠ WARNING</div> <p>ELECTRIC SHOCK HAZARD</p> <p>DO NOT TOUCH TERMINALS TERMINALS ON BOTH THE LINE AND LOAD SIDES MAY BE ENERGIZED IN THE OPEN POSITION</p> </div>
<p>Interconnection breaker labeled NEC 2020 690.54</p> <div style="background-color: #c00000; color: white; padding: 10px; text-align: center; font-weight: bold; font-size: 1.2em;"> <p>INTERCONNECTION SITE</p> </div>
<p>Warning not to relocate interconnection breaker sticker NEC 2020 705.12 (B) (3) (2)</p> <div style="background-color: #c00000; color: white; padding: 10px; text-align: center; font-weight: bold; font-size: 1.2em;"> <p>BREAKER IS BACKFED DO NOT RELOCATE</p> </div>

Labeling Guide NEC 2020 Code

Plaque (listing disconnects and locations or directory) 710.10, 712.10

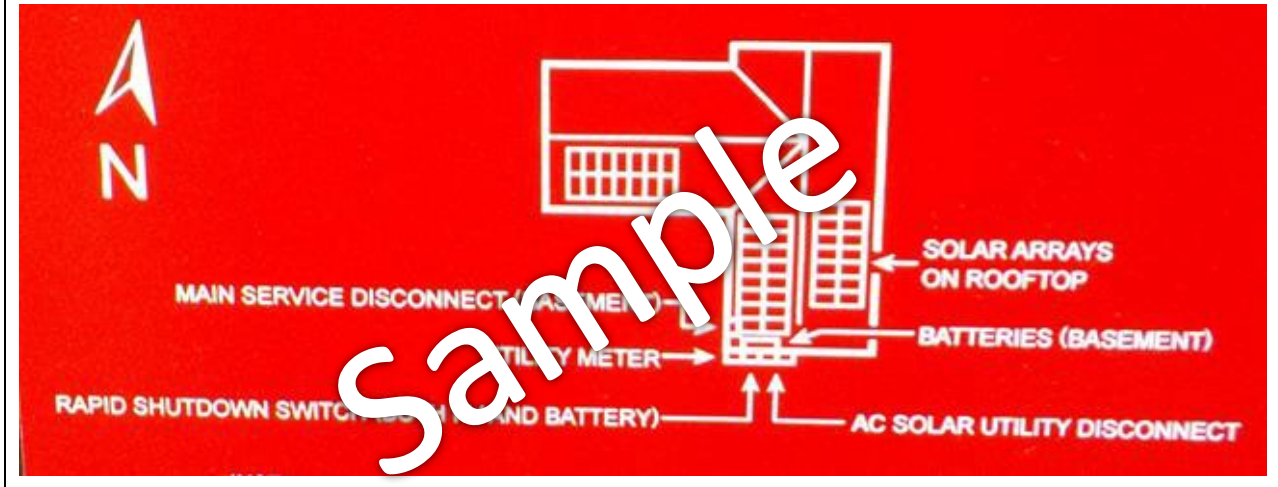

Emergency Shutoff Switch

Labeled as Emergency Shutoff Switch



Labeling Guide NEC 2020 Code


Microgrid Interconnection Device (MID)

Formerly known as (**Automatic or Manual Transfer Switch**)

Multiple sources of AC power Sticker NEC 2020 705.12 (C)



Terminals on the line and load side sticker NEC 2020 690.13 (B)

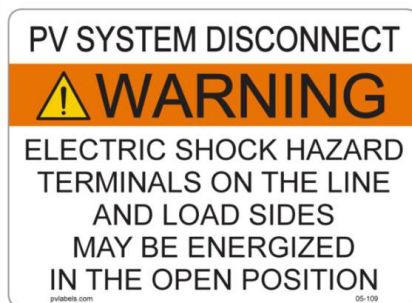

Battery Stack (DC Energy Storage Devices)

Battery Stack Disconnect Labeled 480.7 (F), 110.16



Label "Energy Storage Systems" (Voltage and Amperage) 706.15 (C)

